



*Powerhouse Two Inc.*

---

*Excellent Quality, Prompt Delivery and Competitive Price*

# Technical Specification

XP Alkaline Manganese Dioxide Battery

To:

Model: PH-AA-XP

Prepared by: GH

Checked by: TW

Approved by: CC

Powerhouse Two Inc.  
120 West Crown Point Road  
Suite 112  
Winter Garden, FL 34787

PH 407-654-5451

Fax 407-654-2795

[www.PowerHB.com](http://www.PowerHB.com)

[Tom.Wirbel@PowerHB.com](mailto:Tom.Wirbel@PowerHB.com)



# Powerhouse Two Inc.

---

## 1. Scope

This specification is applicable to Powerhouse Two's XP Super Alkaline Battery.

### 1.1 Designations

PH-AA-XP    GSLR6A    LR6    AM-3    15A    AA    E91

### 1.2 Reference Document

IEC 60086-1 (2006-12) – Primary Batteries – Part 1: General  
IEC 60086-2 (2006-12) – Primary Batteries – Part 2: Physical and Electrical Specifications  
IEC 60086-5 (2006-12) – Primary Batteries – Part 5: Safety of batteries with aqueous electrolyte

## 2. Chemical System    Alkaline Manganese Dioxide

- Mercury and Cadmium are not added

3. Nominal Voltage    1.5 volt

4. Average Weight    23.5g

5. Nominal Capacity    2850 mAh

Condition: Continuous discharge at  $20 \pm 2^\circ$  C under  $75\Omega$  load for 24 hours per day to EPV 0.8V.



# Powerhouse Two Inc.

## 6. Electrical Characteristics

Test Conditions: Tested within 30 days after delivery

Load resistance: 3.9 ohms  $\pm$  0.5%

Temperature: 20  $\pm$  2 ° C

Measuring time: 0.3 seconds

	Off-Load Voltage OCV (V)	On-Load Voltage CCV (V)	Test Specification
New Battery	1.58	1.45	MIL-STD-105E Class II Double Sampling, AQL=0.4
After 3 months at Temp. 45° -C	1.56	1.40	
After 12 months at Room temperature	1.56	1.40	

## 7. Service Output

Test Conditions: Tested within 30 days after delivery

Temperature: 20  $\pm$  2 degrees C

Standard	Discharge Condition			Average Minimum Discharge Time		
	Discharge Load	Daily Discharge Time	EPV (V)	New Battery	After 3 Months at 45 C	After 12 Months at Room Temp
IEC	43 $\Omega$	4 h/d	0.9 V	94.7 h	94.7 h	85.7 h
IEC	3.9 $\Omega$	1h/d	0.8 V	8.4 h	8.4 h	7.56 h
IEC	10 $\Omega$	1h/d	0.9 V	20.4 h	20.4 h	18.36 h
IEC	250 mA	1 h/d	0.9 V	8.36 h	8.36 h	7.52 h
IEC	1000 mA	10 s/m, 1 h/d	0.9 V	512 cycles	512 cycles	461 cycles
IEC	24 $\Omega$	15 s/m, 8 h/d	1.0 0.9 V	47.6 h	47.6 h	42.84 h
REF	10 $\Omega$	24 h/d	0.9 V	20.4 h	20.4 h	18.36 h



# Powerhouse Two Inc.

## Acceptance Criteria

1. Nine (9) pieces of battery product will be tested for each discharging standard
2. The result of the average discharging time from each discharging standard shall be equal to or more than the average minimum time requirement: and no more than one battery has a service output less than 80% of the specified requirement.
3. One re-test is allowed to confirm the previous result

## 8. Electrolyte Leakage Proof Characteristics

Item	Condition	Period	Requirements	Acceptance Standard
Over-discharge Characteristics	<ol style="list-style-type: none"> <li>1. 10 <math>\Omega</math> continuous discharge</li> <li>2. Storage Temp – <math>20 \pm 2</math> ° C</li> <li>3. Relative Humidity <math>90 \pm 20\%</math> RH</li> </ol>	48 Hrs.	There shall be no deformation exceeding the specified dimensions, nor leakage recognized by the human eye.	N=30 Ac=1 Re=2
Storage Characteristics	<ol style="list-style-type: none"> <li>1. Storage Temp <math>60 \pm 2</math> ° C</li> <li>2. Relative Humidity <math>90 \pm 5\%</math> RH</li> </ol>	30 Days		N=9 Ac=0 Re=2

## 9. Safety Characteristics

Item	Condition	Period	Requirements	Acceptance Standard
Short Circuit Characteristics	Temp $20 \pm 2$ ° C	24 Hrs.	There shall be no explosion of the battery	N=9 Ac=0 Re=1
Abusive Characteristics	Charging current 80 mA Temp $20 \pm 2$ ° C	24 Hrs.		



## Powerhouse Two Inc.

---

### 10. Marking

The following markings will be printed, stamped, or impressed on the body of the battery.

- |                |  |
|----------------|--|
| 1. Designation | PH-AA-XP Alkaline  |
| 2. Polarity    | "+" & "-"<br>Located on cathode can  |
| 3. Others      | 3.1 1.5V GSLR6A AM3 LR6<br>3.2 AA Size 0.00% Mercury & Cadmium<br>3.3 Made in China<br>3.4 Marking of separate collection (Logo)               |
| 4. Warning     | Do not dispose of in fire, recharge, put in backwards, or mix with used or other battery types. May explode or leak and cause personal injury. |

### 11. Caution for Use

1. Since the battery is not manufactured for recharging, there are risks of electrolyte leakage causing damage to the device if the battery is recharged.
2. The battery shall be installed with its "+" and "-" polarity in the correct position, otherwise it might cause a short circuit.
3. Short circuiting, heating, or disposing into fire and disassembling is prohibited.
4. Battery cannot be subjected to a forced discharge, which can lead to internal gas generation which may result in bulging, leakage, and de-crimping of cap.
5. New and used batteries cannot be used at the same time. When replacing batteries, replace all batteries together with the same type.
6. Exhausted batteries should be removed from compartment to prevent over-discharge, which causes leakage and damage to the device
7. Direct soldering will cause damage to the battery
8. Battery should be kept out of the reach of children to prevent swallowing. In case of accident, contact physician immediately.
9. The battery should never be dismantled or deformed.



# Powerhouse Two Inc.

## 12. Shelf Life

3-5 Years after delivery under proper storage conditions. (90% original charge)


Storage Conditions

Temperature  $20 \pm 2^\circ \text{C}$

Relative Humidity  $65 \pm 20\% \text{RH}$

## 13. Discharge Curves


Fig. 1 Test Temperature -  $20 \pm 2^\circ \text{C}$   
Discharge Method -  $43 \Omega$  4 hr/day

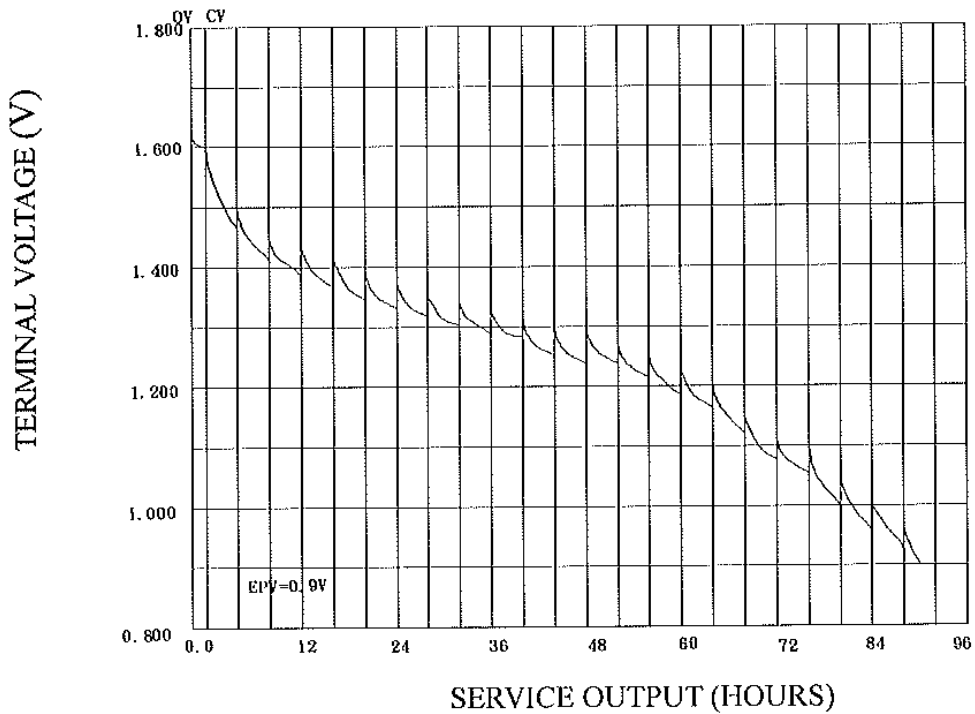



Discharge Curves

Fig. 2 Test Temperature -  $20 \pm 2^\circ \text{C}$   
Discharge Method -  $10 \Omega$  1 Hr/day

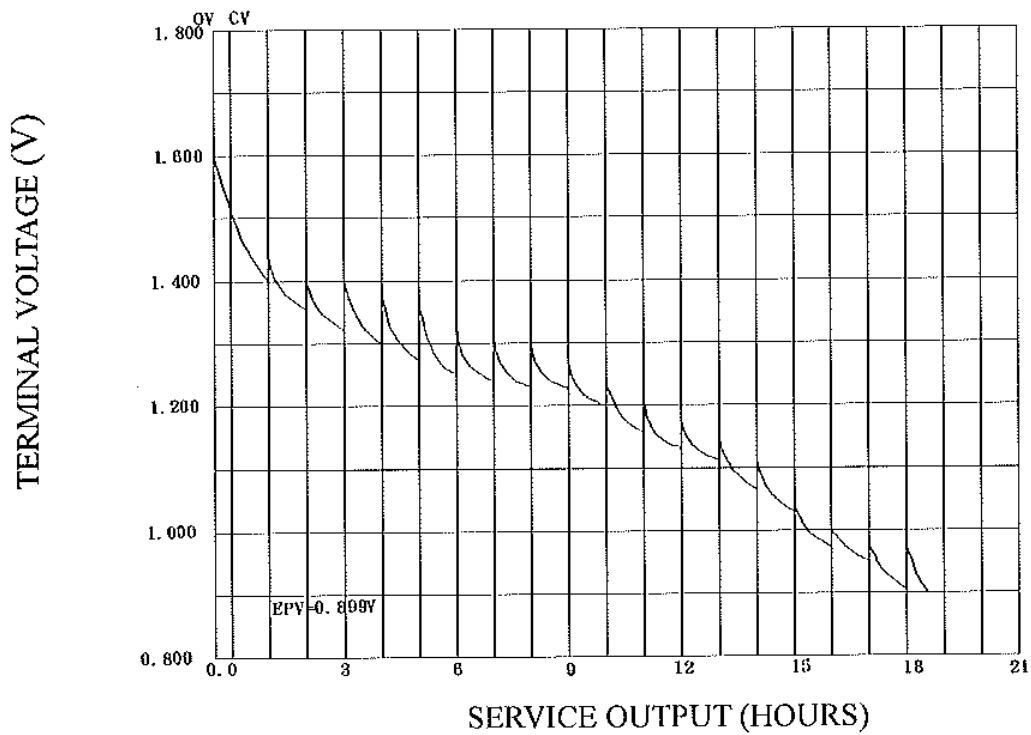

14. Compliance & Environmental Information


This product complies with the EU RoHS Directive 2002/95/EC and Battery Directive 2006/66/EC and meets all US standards set by the EPA for Alkaline Manganese batteries. MSDS available upon request.



Powerhouse Two Inc.

## 15. Battery Dimension

### PH-AA-XP Battery Dimensions and Structure

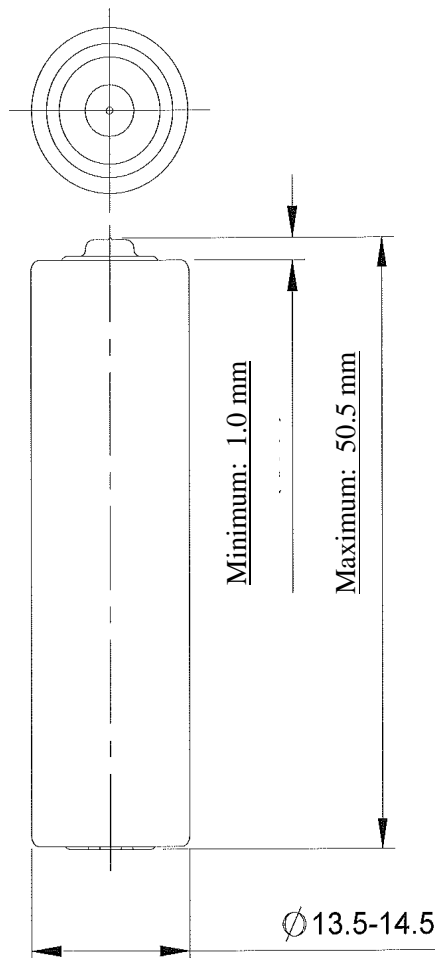

Powerhouse Two Inc.		
Model: PH-AA-XP	Drawing number: DWG-S-001	
Scale: NTS	Dim: mm	Approved by: T. Wirbel - C. Chu
Date: 01/21/2010	Drawn by: Kelvin	
Tolerances: Linear $\pm 1$ Angular $\pm \frac{1}{4}$ 3 <sup>rd</sup> angle projection		